




K.R.E. Society's

# R.V BIDAP LAW COLLEGE BIDAR

(Approved by BCI Delhi & Permanently Affiliated to Karnataka State Law University, Hubballi)  
MANHALLI ROAD, BIDAR - 585 403. ( KARNATAKA STATE) INDIA

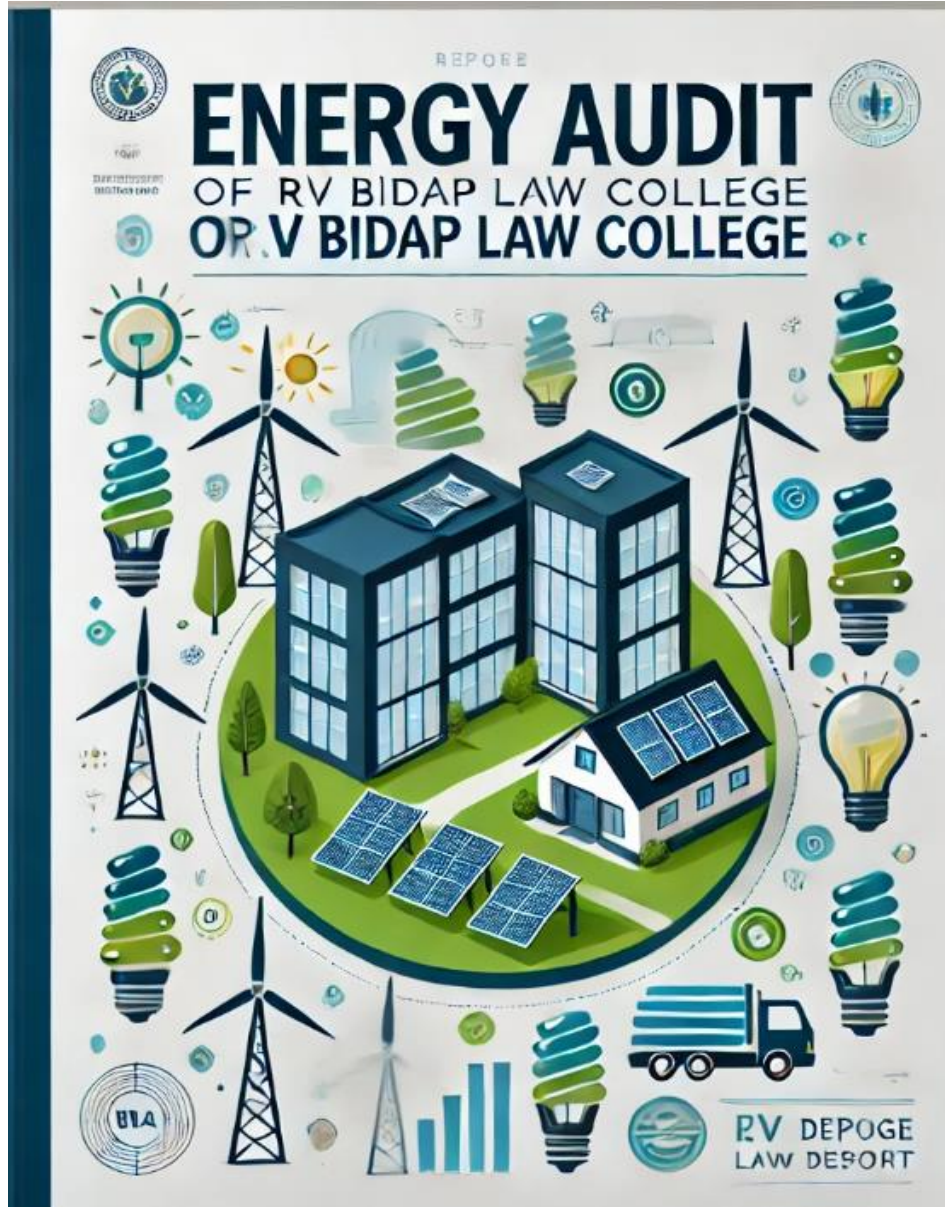

*Shweta*  
**Smt Shweta Patil**  
Course of Renewable Energy  
Bachelor of Vocation  
KASCC, Bidar  
Renewable Energy

*Leelaj*  
**Auditor** ಅಭಿಯಂತರರು (ಸಿ)  
GESCOM Office  
ಸಹಾಯಕ ಕಾರ್ಯನಿರ್ವಾಹಕ ಅಧಿಕಾರಿ-ವಿಭಾಗ  
ಗು.ವಿ.ಸ.ಕಂ.ನಿ. ಹುಮನಾಟಾದ

## ACKNOWLEDGEMENT

We the Auditors from the department of B.Voc. Renewable Energy, Karnatak Arts, Science and Commerce College, Bidar & GESCOM OFFICE, HUMNABAD express our sincere gratitude to the management of RV Bidap Law College, Bidar, for awarding us the assignment of Energy Audit of their campus for the Year: 2018-2020

We are thankful to various Head of Departments & other Staff members for helping us during the field measurements

  
**Smt Shweta Patil**  
Course of Renewable Energy  
Bachelor of Vocation  
KASCC, Bidar  
Renewable Energy

  
**Auditor** ಅಭಿಯಂತರರು (ಸಿ)  
GESCOM Office  
ಗು.ವಿ.ಸ.ಕಂ.ನಿ. ಹುಮನಾಟಾದ

## EXECUTIVE SUMMARY

An energy audit was carried out at R V BIDAP Law College to assess the current energy consumption and identify opportunities for reducing energy use. The audit covered various areas of the campus, including classrooms, offices, and common areas, with a focus on lighting, ventilation, and office equipment.

1. Present Energy Consumption:

No	Parameter /Value	Electrical Energy Consumed, kWh	CO2 Emissions, MT
1	Total	2991	2.691
2	Maximum	310	0.279
3	Minimum	212	0.190
4	Average	261	0.234

2. Various Majors Adopted for Energy Conservation:

- Usage of Energy efficient LED fittings
- Usage of BEE STAR Rated Equipment
- Maximum usage of Day Lighting

3. Notes : 1 kWh of Electrical Energy releases 0.9 Kg of CO<sub>2</sub> into atmosphere

  
**Smt Shweta Patil**  
Dept. of Renewable Energy  
Bachelor of Vocation  
KASCE, Bidar  
Renewable Energy

  
**Auditor** ಅಭಿಯಂತರರು (ಸಿ)  
ಸಹಾಯಕ ಕಾರ್ಯದರ್ಶಿ  
GESCOC Office - ವಿಭಾಗ  
ಗು.ವಿ.ಸ.ಕಂ.ನಿ. ಹುಮನಾಟಾದ

## ABBREVIATIONS

CFL : Compact Fluorescent Lamp

FTL : Fluorescent Tube Light

LED : Light Emitting Diode

kWh : kilo-Watt Hour

Qty : Quantity

W : Watt

kW : Kilo Watt

PC : Personal Computer

MT : Metric Ton

  
**Smt Shweta Patil**  
Course of Renewable Energy  
Bachelor of Vocation  
KASCE, Bidar  
Renewable Energy

  
**Auditor** ಅಭಿಯಂತರರು (ಸಿ)  
GESCO Office - ವಿಭಾಗ  
ಗು.ವಿ.ಸ.ಕಂ.ನಿ. ಹುಮನಾಟಾದ

## CHAPTER-I

### INTRODUCTION

An energy audit was conducted at R V BIDAP Law College to assess the current energy consumption patterns and identify potential areas for energy savings. The audit focused on the various electrical installations within the college, including lighting, fans, and office equipment. The data collected includes the number and types of lights, ceiling fans, computers, printers, and other electronic devices used in different locations across the college.

### Objectives

The primary objectives of the energy audit were to:

1. Identify areas of excessive energy consumption.
2. Recommend measures to improve energy efficiency.
3. Promote sustainable energy practices within the campus
4. To study the present CO<sub>2</sub> emission
5. To study LED Lighting.

Table No1: General Details of College:

No	Head	Particulars
1	Name of Institution	Karnatak Law College, Bidar
2	Address	
3	Affiliation	

  
**Smt Shweta Patil**  
Course of Renewable Energy  
Bachelor of Vocation  
KASCE, Bidar  
Renewable Energy

  
**Auditor** ಅಭಿಯಂತರರು (ಸಿ)  
GESCOM Office  
ಸಹಾಯಕ ಕಾರ್ಯದರ್ಶಿ, ಶಿಬಿರ - ವಿಭಾಗ  
ಗು.ವಿ.ಸ.ಕಂ.ನಿ. ಹುಮನಾಟಾದ

## CHAPTER-II

### STUDY OF CONNECTED LOAD

In this chapter, we present the details of various Electrical loads as under

Table No 2: Details of Equipment Wise Connected Load:

Sl.No.	Equipments	Quantity	Load W/Unit	Load in kW
1	40W FTL	22	40	0.880
2	20W LED	05	20	0.100
3	20W CFL	03	20	0.060
4	Ceiling fans	25	6	0.150
5	PC	19	150	2.850
6	Scanner	01	175	0.175
7	Projector	01	350	0.350
8	Other Load	18	150	2.700
	<b>Total</b>			<b>7.265</b>

  
**Smt Shweta Patil**  
Course of Renewable Energy  
Bachelor of Vocation  
KASCE, Bidar  
Renewable Energy

  
**Auditor** ಅಭಿಯಂತರರು (ಸಿ)  
GESCO Office - ವಿಭಾಗ  
ಗು.ವಿ.ಸ.ಕಂ.ನಿ. ಹುಮನಾಟಾದ

## CHAPTER-III

### STUDY OF Present Energy CONSUMPTION

In this chapter, we present the analysis of last year Electricity Energy Consumption

Table No 3: Electrical Energy Consumption Analysis- 2023-24:

No	Month	Total Energy Consumed, kWh
1	May	250
2	June	240
3	July	218
4	August	230
5	September	198
6	October	300
7	November	234
8	December	256
9	January	310
10	February	212
11	March	263
12	April	280
	Total	2991

  
**Smt Shweta Patil**  
Course of Renewable Energy  
Bachelor of Vocation  
KASCE, Bidar  
Renewable Energy

  
**Auditor** ಅಭಿಯಂತರರು (ಸಿ)  
GESCOM Office - ವಿಭಾಗ  
ಗು.ವಿ.ಸ.ಕಂ.ನಿ. ಹುಮನಾಟಾದ

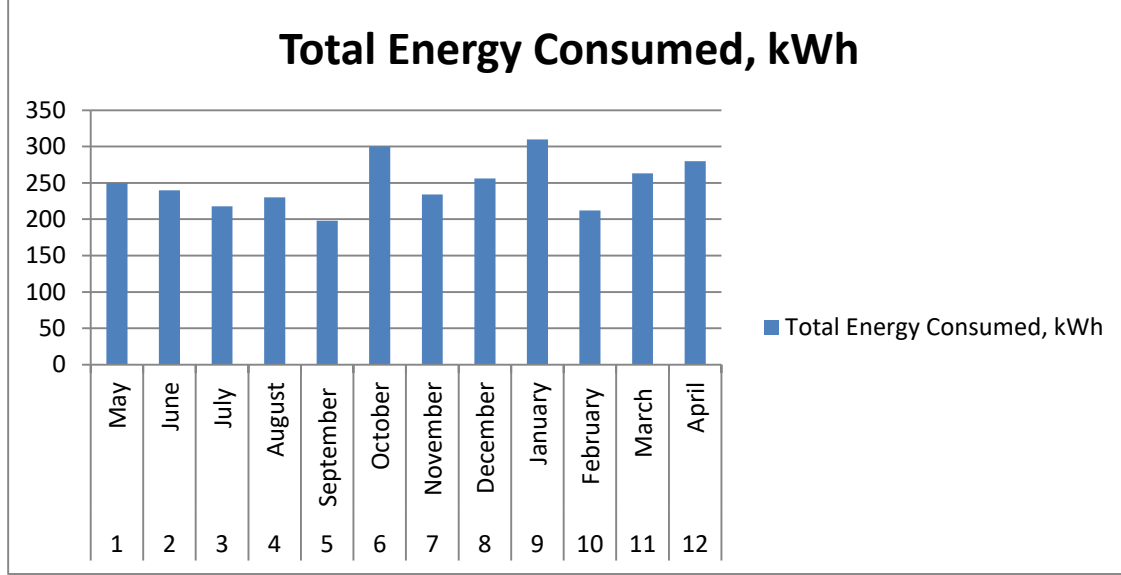


Table No. 4 Variations in Important Parameters

No.	Parameters/Variation	Energy Purchased kW
1	Total	2991
2	Maximum	310
3	Minimum	212
4	Average	261

  
**Smt Shweta Patil**  
 Course Coordinator  
 Bachelor of Vocation  
 Renewable Energy  
 KASCE, Bidar

  
**Auditor**  
 ಸಹಾಯಕ ಕಾರ್ಯದರ್ಶಿ ಅಭಿಯಂತರರು (ಸಿ)  
 ಗೌ.ವಿ.ಸ.ಕಂ.ನಿ. ಕುಮನಾಟಾದ  
**GESCOM Office**



## CHAPTER-IV

### CARBON FOOTPRINTING

A Carbon Foot print is defined as the Total Greenhouse Gas emissions, emitted due to various activities.

In this we compute the emissions of Carbon-Di-Oxide, by usage of the various forms of Energy used by the College for performing its day to day activities. The College uses Electrical Energy for various Electrical gadgets.

Basis for computation of CO<sub>2</sub> Emissions:

The basis of Calculation for CO<sub>2</sub> emissions due to Electrical Energy is 1 kWh of Electrical Energy releases 0.9 Kg of CO<sub>2</sub> into atmosphere

Based on the above Data we compute the CO<sub>2</sub> emissions which are being released in to the atmosphere by the College due to its Day to Day operations

Table No 5: Month wise CO<sub>2</sub> Emissions:

No	Month	Total Energy Consumed, kWh	CO <sub>2</sub> emissions, MT
1	May	250	0.225
2	June	240	0.216
3	July	218	0.196
4	August	230	0.207
5	September	198	0.178
6	October	300	0.270
7	November	234	0.210
8	December	256	0.230
9	January	310	0.279
10	February	212	0.190
11	March	263	0.236
12	April	280	0.252
13	Total	2991	2.691

  
**Smt Shweta Patil**  
Course Coordinator  
Bachelor of Vocation  
KASCE, Bidar  
Renewable Energy

  
**Auditor** ಅಭಿಯಂತರರು (ಸಿ)  
GESCOM Office  
ಗು.ವಿ.ಸ.ಕಂ.ನಿ. ಹುಮನಾಟಾದ

14	Maximum	310	0.279
15	Minimum	212	0.190
16	Average	261	0.234

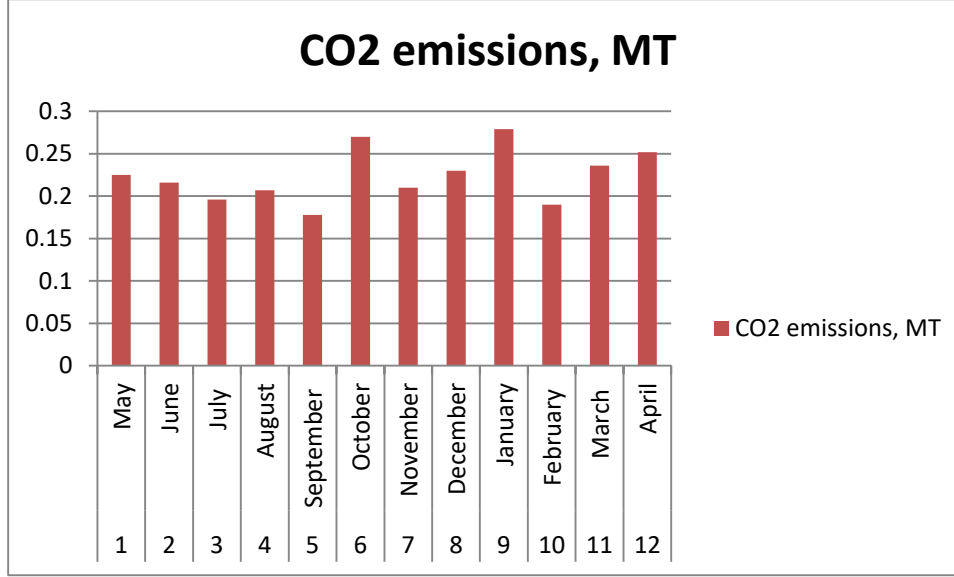


Table No. 6 : Important Parameters

No	Parameter /Value	Electrical Energy Consumed, kWh	CO2 Emissions, MT
1	Total	2991	2.691
2	Maximum	310	0.279
3	Minimum	212	0.190
4	Average	261	0.234

  
**Smt Shweta Patil**  
 Dept. of Renewable Energy  
 Bachelor of Vocation  
 KASCE, Bidar  
 Renewable Energy

  
**Auditor**  
 ಸಹಾಯಕ ಕಾರ್ಯದರ್ಶಿ (ಸಿ)  
 ಗಣಿ ಮತ್ತು ಭೂ ವಿಜ್ಞಾನ - ವಿಭಾಗ  
**GESCOM Office**  
 ಗು.ವಿ.ಸ.ಕಂ.ನಿ. ಹುಮನಾಟಾದ

**Study of Connected Load**  
**Location Wise Connected Load**

Sl.No.	Location	No. of Florescent lamp (Tube Lights)	No of CFL's (watt )	No of LED's (watt )	No. of Ceiling Fan's	No. of PC's	No. of Printers
01	G6	02			01		
02	G7	01			02		
03	G8	02			01	01 projector	
04	G5	01			01		
05	G4	02			01	02	01 scanner
06	G3	01			01	01	
07	G2	02		02	02		
08	G1	-	01		01		
01	F10	01	02		03	02	
02	F9	02			02	14	
03	F7	03		03	03		
04	F1	01			02		
01	S4	01			02		
02	S6	02			01		
03	S7	01			02		
	<b>Total</b>	<b>22</b>	<b>03</b>	<b>05</b>	<b>25</b>	<b>19pc+01 proj.</b>	<b>01 scanner</b>

  
**Smt Shweta Patil**  
 Dept. of Renewable Energy  
 Bachelor of Vocation  
 KASCE, Bidar  
 Renewable Energy

  
**Auditor**  
 ಸಹಾಯಕ ಕಾರ್ಯದರ್ಶಿ ಅಭಿಯಂತರರು (ಸಿ)  
 ಗೌ.ವಿ.ಸ.ಕಂ.ನಿ. ಕುಮನಾಟಾದ  
**GESCOM Office**

## Recommendations:

- 1. LED Lighting:** Replace all fluorescent lamps and CFLs with LED lights, which are more energy-efficient and have a longer lifespan.
- 2. Energy-Efficient Ceiling Fans:** Consider replacing existing ceiling fans with energy-efficient models.
- 3. Optimize Ventilation Systems:** Regular maintenance and potential replacement of old fans with energy-efficient models can improve energy efficiency.
- 4. Optimize Computing Equipment:** Ensure that PCs and printers are turned off when not in use to avoid standby power consumption.

## Conclusion

The energy audit conducted at R V BIDAP Law College revealed significant opportunities for enhancing energy efficiency across the campus. The audit highlighted key areas where energy consumption could be reduced through targeted interventions. By implementing the recommended measures, the college can achieve greater energy efficiency, leading to cost savings and a reduced environmental impact.

  
**Smt Shweta Patil**  
Course of Renewable Energy  
Bachelor of Vocation  
KASCC, Bidar  
Renewable Energy

  
**Auditor**  
ಸಹಾಯಕ ಕಾರ್ಯನಿರ್ವಾಹಕ ಅಭಿಯಂತರರು (ಸಿ)  
ಕೆ.ಎಸ್.ಸಿ.ಎಂ.ಐ.ಸಿ. - ವಿಭಾಗ  
**GESCOM Office**  
ಗು.ವಿ.ಸ.ಕಂ.ನಿ. ಹುಮನಾಟಾದ